


Galil DMC-4080
EXTENDED I/O CONNECTIONS

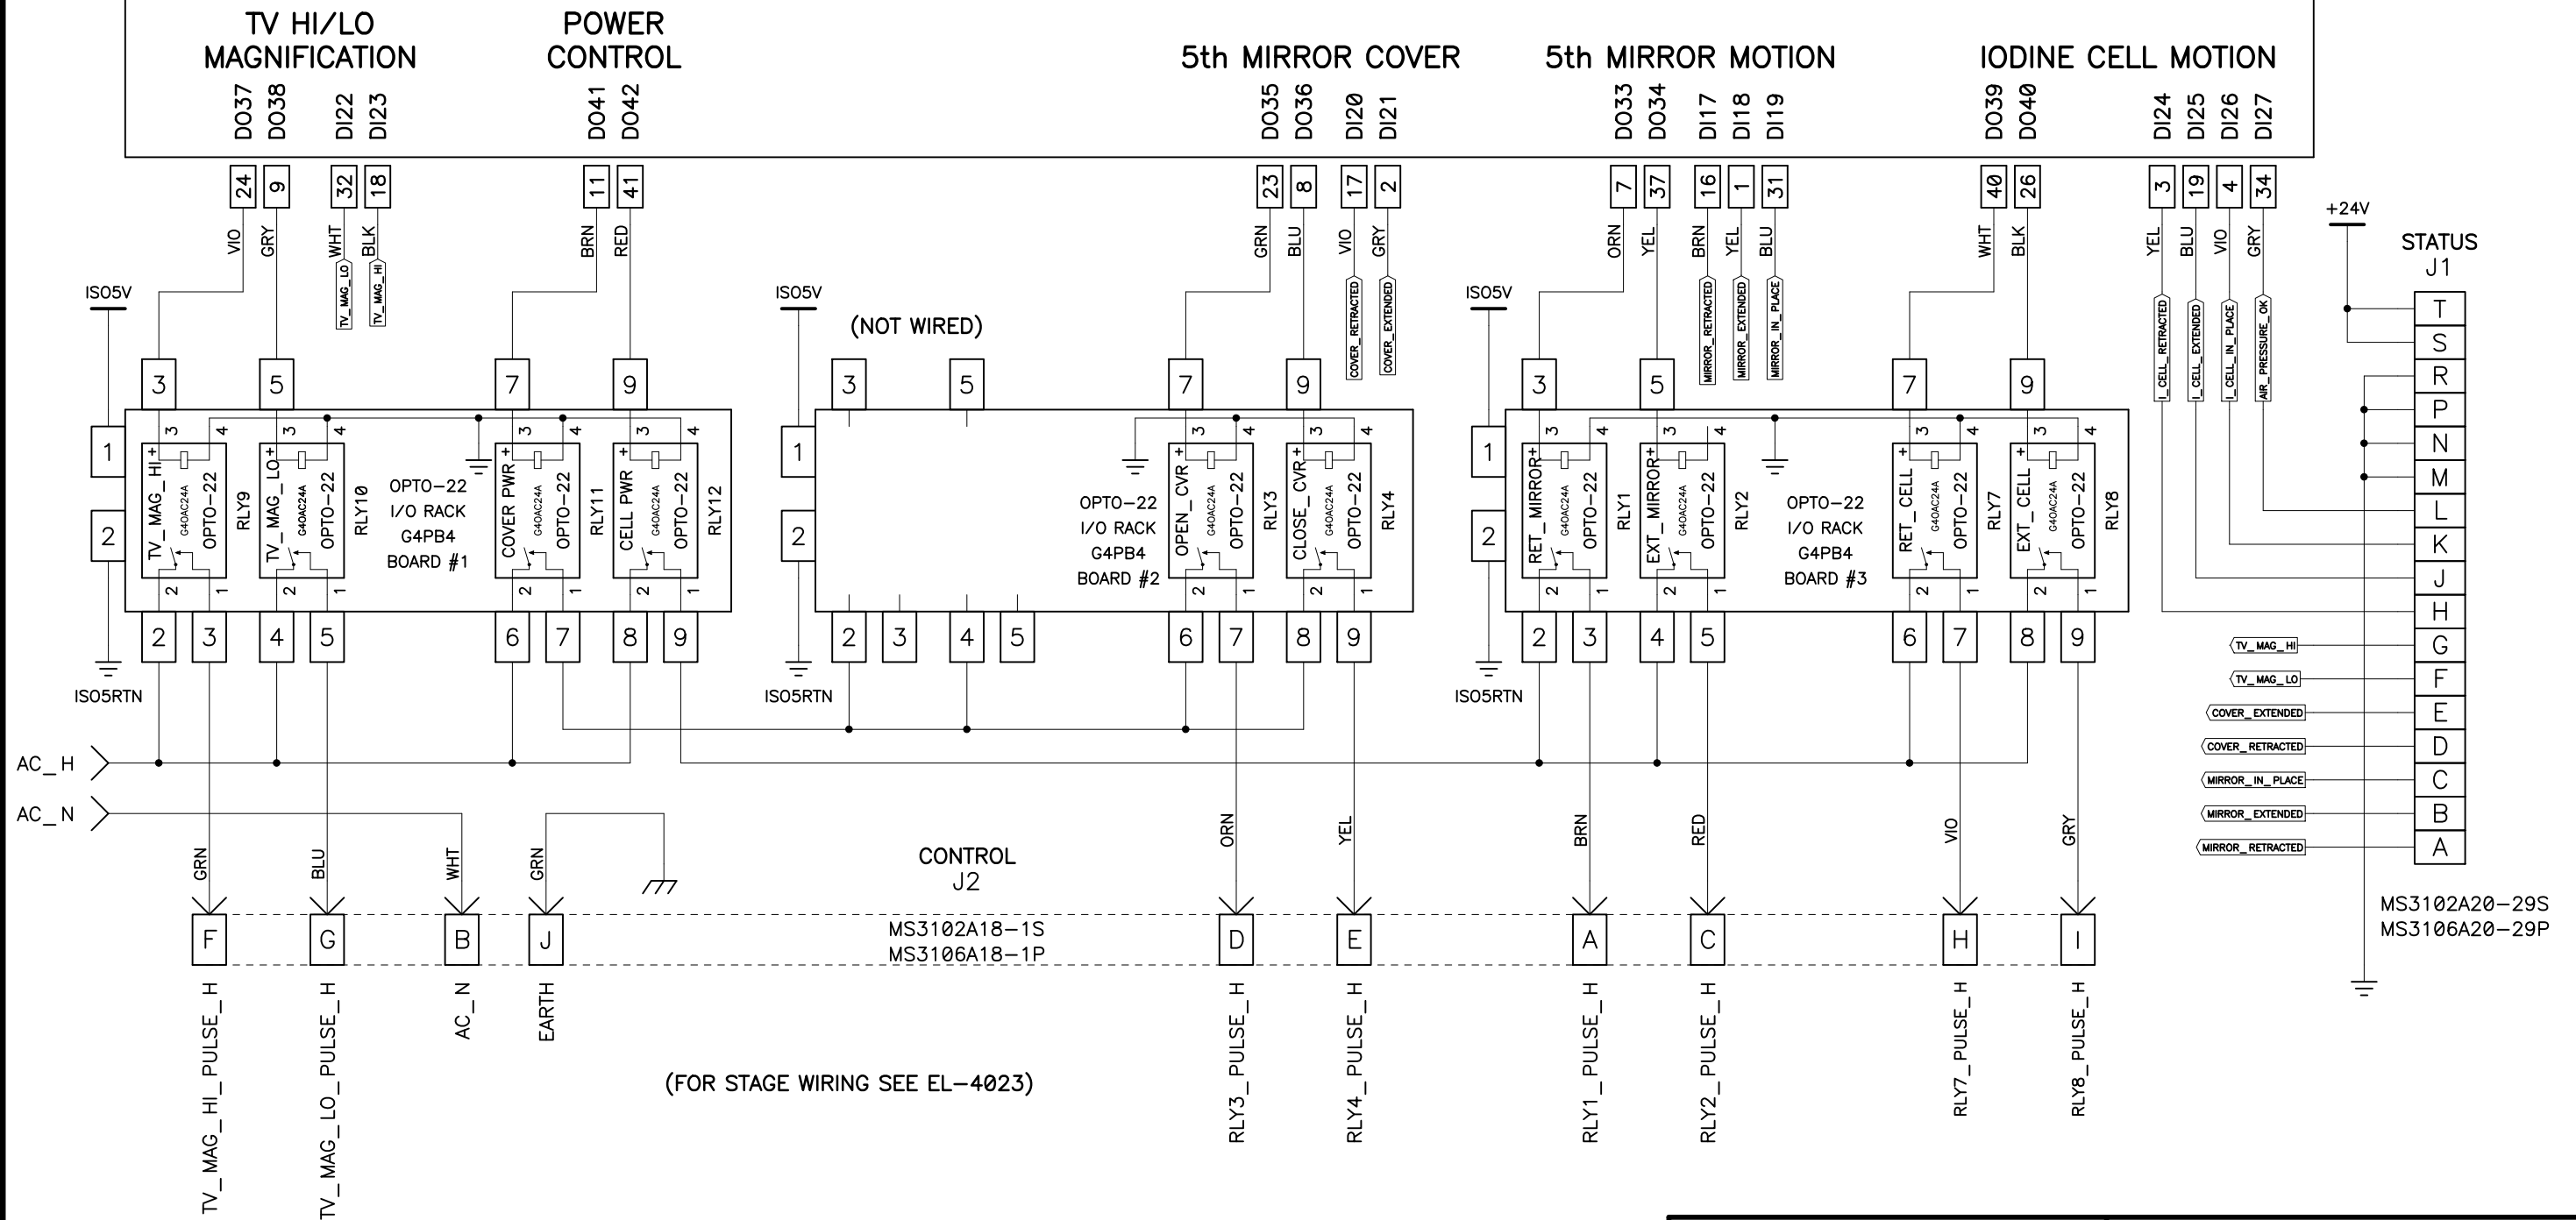

(FOR STAGE WIRING SEE EL-4023)

UNIVERSITY OF CALIFORNIA LICK OBSERVATORY		CONTROLLER BOX WIRING EXTENDED I/O HAMILTON SPECTROGRAPH II	
DES'N BY: B. Alcott		ORIGIN DATE: 04-15-08	DWG. NO. NUM. 1 OF 4
Last SN		MODIFY DATE: 11-03-09	REV. A
PRINT TIME: 06:41:21		PRINT DATE: Fri Mar 12, 2010	EL-4010
PATH: Hamilton_II\		HAM_II_slit_room_wiring.SCH	

REVISIONS http://loel.ucolick.org/manual/Hamilton_II/schematics/HAM_II_slit_room_wiring_sh_1.pdf
 10-19-09 REDREW SCHEMATIC FOR INTEGRATION INTO HAMILTON UPGRADE CONTROLLER CHASSIS FROM STANDALONE BOX (REF. EL-4032 SHEET 1)
 11-03-09 ADDED GUIDE TV MAGNIFICATION SIGNALS (OUTPUTS BITS 37 & 38 INPUT BITS 22 & 23)